


Schematic of electrical controls

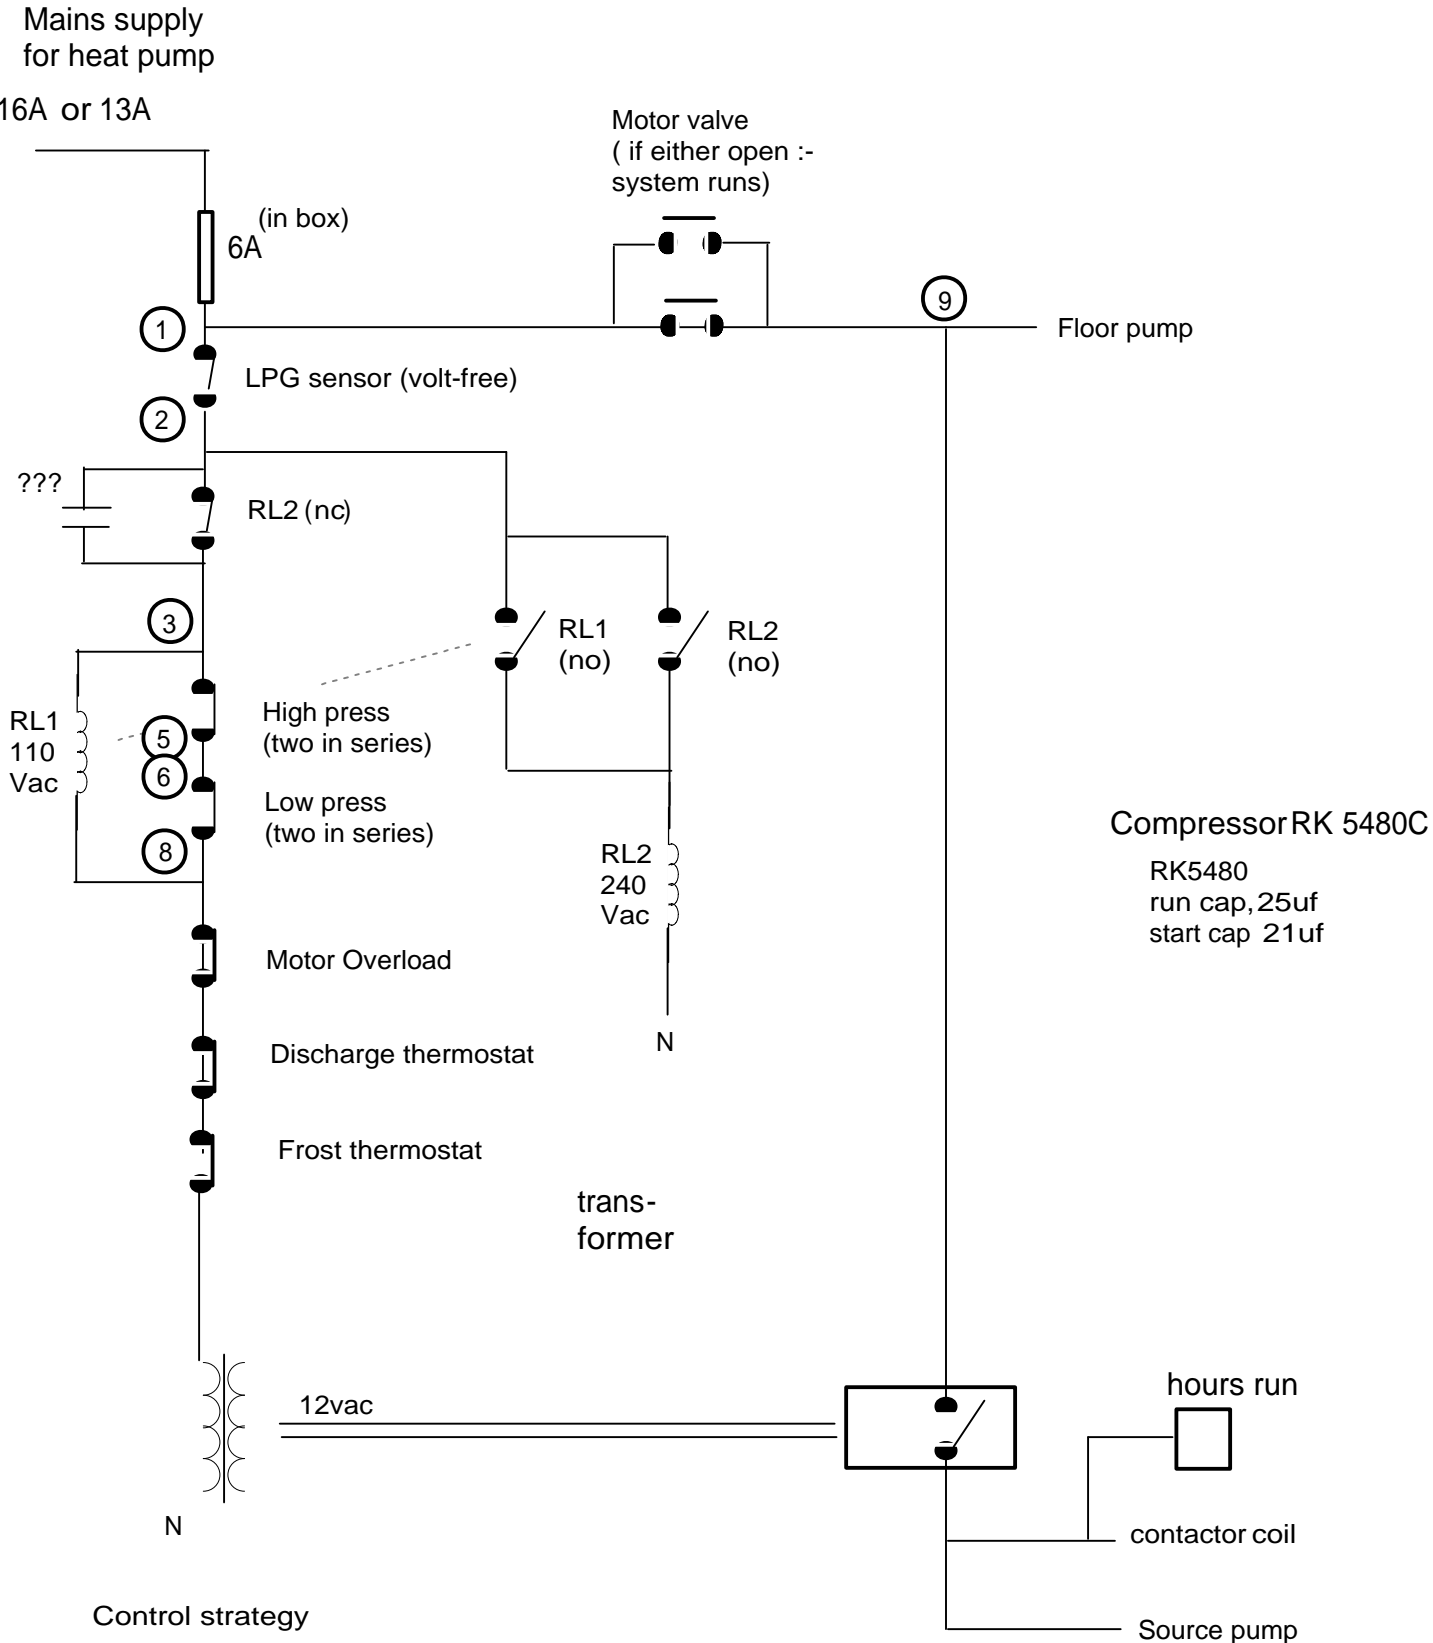

16A supply, but 13A is no problem. either will do.

Small contactor with overload

Cut-out string includes LPG sensor, hp, ol, disch. transformer at end of string.

delay start in digital stat uses as short-cycle protection.

If call for heat, floor pumps runs.

Floor pump or source pump run-on not thought necessary

If HL/HP trips, system latched off (Lock-out). reset by turning mains off/on.